


UBC – Zone 4

12HX300

Essential - At or Below Grade

Battery Rack

5 TIER RACK SHOWN

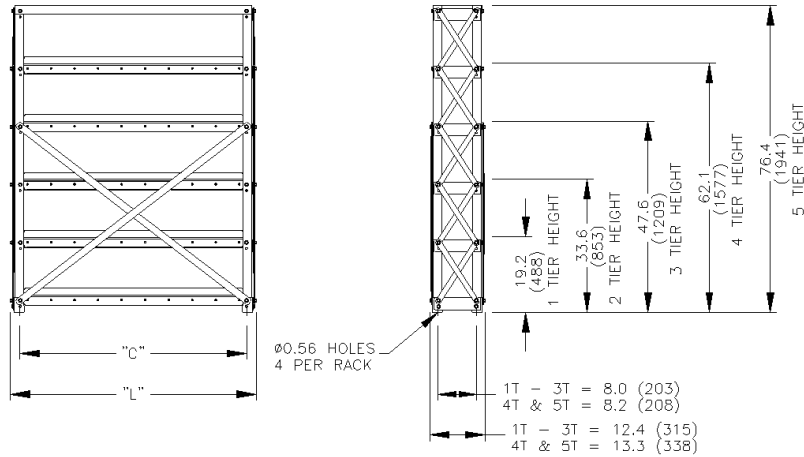

- AZMS UJB1 – 1 Tier
- UJB2 – 2 Tier
- UJB3 – 3 Tier
- UJB5 – 4 Tier
- UJB9 – 5 Tier

LENGTH Blocs per Row	ROWS per TIER	HEIGHT	CATALOG NO.	DIMENSIONS				UNPACKED WEIGHT		PACKED WEIGHT	
				L		C		lbs	kg	lbs	kg
				in	mm	in	mm				
4 BLOCS	1	1 TIER	U12HX3004J1TZ4A	29.9	759	25.3	643	49	22	99	45
	1	2 TIER	U12HX3004J2TZ4A					78	35	128	58
	1	3 TIER	U12HX3004J3TZ4A	115	52			165	75		
	1	4 TIER	U12HX3004J4TZ4A	270	123			320	145		
	1	5 TIER	U12HX3004J5TZ4A	336	152			386	175		
5 BLOCS	1	1 TIER	U12HX3005J1TZ4A	36.9	937	32.3	820	55	25	105	48
	1	2 TIER	U12HX3005J2TZ4A					86	39	136	62
	1	3 TIER	U12HX3005J3TZ4A	127	58			177	80		
	1	4 TIER	U12HX3005J4TZ4A	299	136			349	158		
	1	5 TIER	U12HX3005J5TZ4A	372	169			422	191		
6 BLOCS	1	1 TIER	U12HX3006J1TZ4A	43.8	1113	39.2	996	61	28	111	50
	1	2 TIER	U12HX3006J2TZ4A					94	43	144	65
	1	3 TIER	U12HX3006J3TZ4A	140	64			190	86		
	1	4 TIER	U12HX3006J4TZ4A	328	149			378	172		
	1	5 TIER	U12HX3006J5TZ4A	408	185			458	208		
10 BLOCS	1	1 TIER	U12HX300101TZ4A	71.5	1816	66.9	1699	85	39	135	61
	1	2 TIER	U12HX300102TZ4A					128	58	178	81
	1	3 TIER	U12HX300103TZ4A	190	86			240	109		
	1	4 TIER	U12HX300104TZ4A	446	202			496	225		
	1	5 TIER	U12HX300105TZ4A	556	252			606	275		

RACK SPECIFICATIONS:

- FRAMES:** Steel members covered with gray acid-resistant polyester powder coating
- HARDWARE:** Zinc-plated steel – RoHS compliant
- SEISMIC:** Designed using 0.495g lateral loading



RACK NOTES:

1. Racks are shipped unassembled. All necessary assembly hardware is included – see note 2.
2. Each frame must be anchored to the floor. Holes are provided at the base of each frame. Please refer to rack diagram for hole size and spacing. Determining the anchor bolt size and supplying the anchor bolts is the responsibility of the customer.
3. For rack installation instructions, please refer to EnerSys® Publication No. US-HXRACK-IM, *Instructions for Assembling DataSafe™ HX UBC Battery Racks*.
4. Each seismic rack should stand alone with a minimum clearance of 4.0 inches (102 mm) from any other object (walls, other racks, etc.).



EnerSys
P.O. Box 14145
Reading, PA 19612-4145
USA
Tel: +1-610-208-1991
+1-800-538-3627
Fax: +1-610-372-8613

EnerSys EMEA
Brussels, Belgium
Tel: +32 (0)2 247 94 47

EnerSys Asia
Guangdong, China
Tel: +86 755 2689 3639

Represented by: